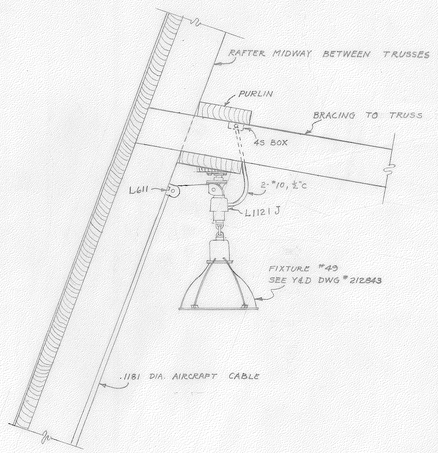

DETAIL "B"

NO SCALE

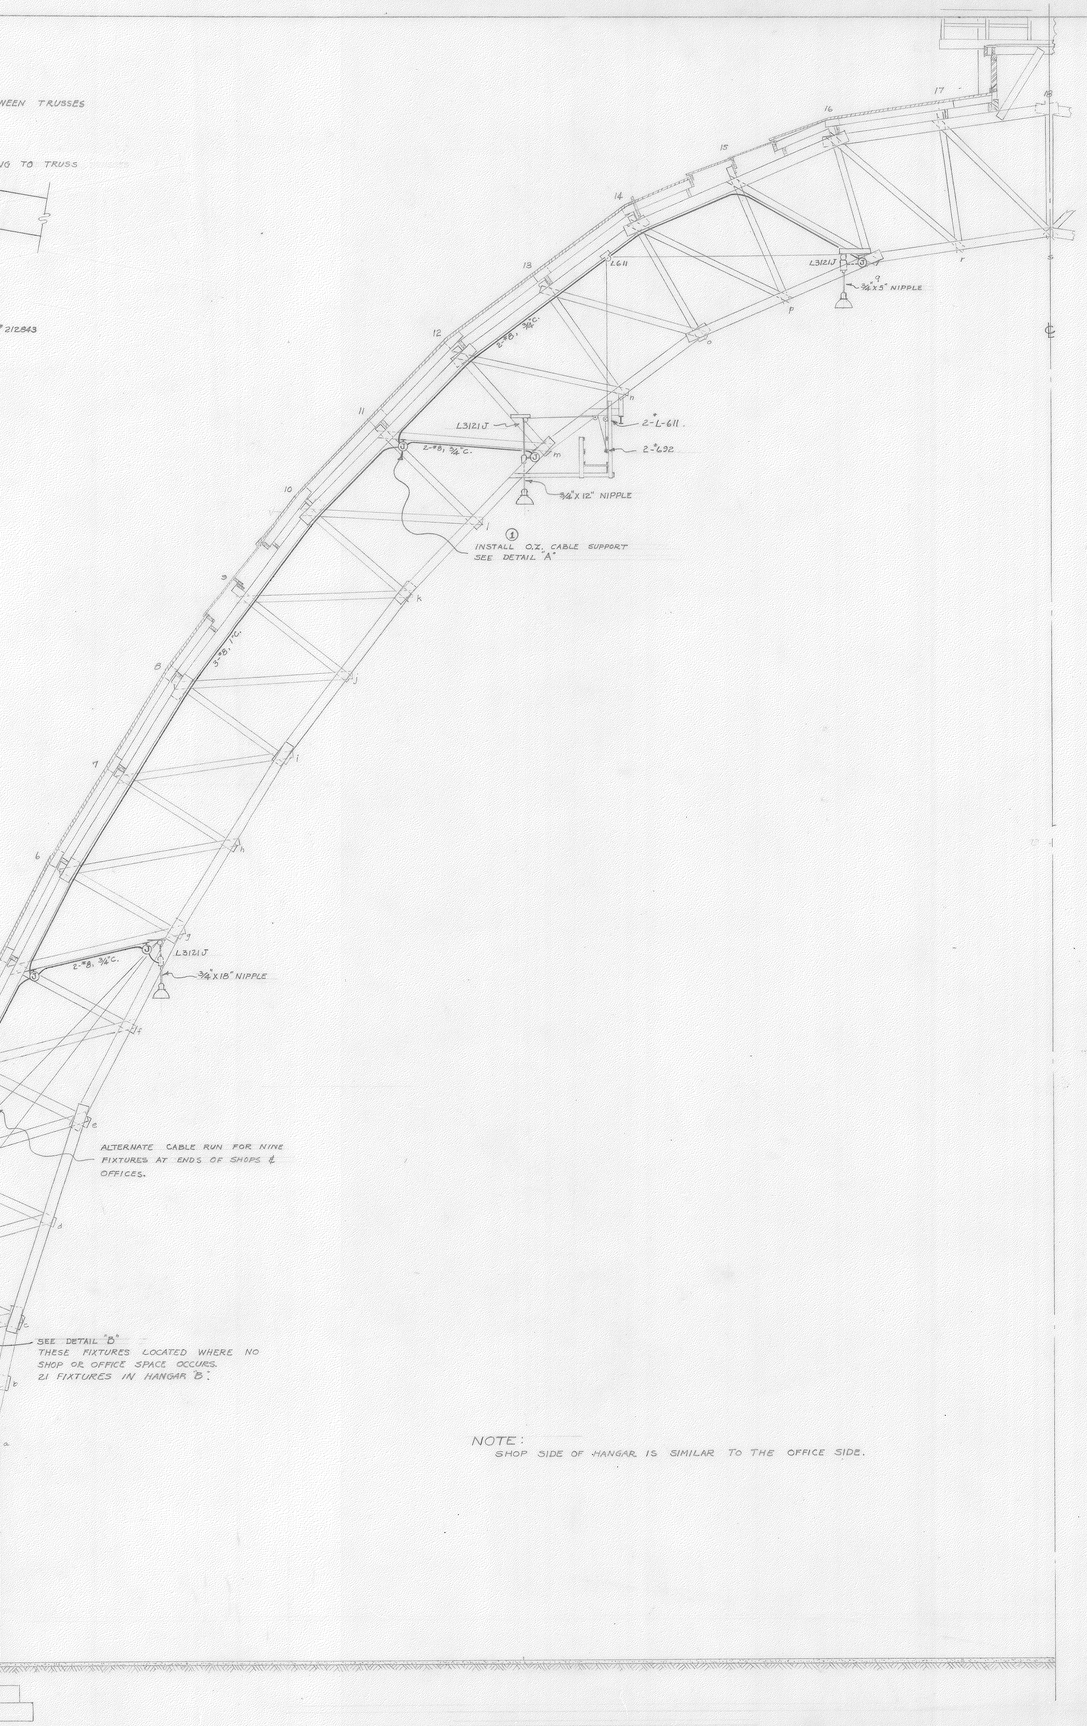

NOTE:
SHOP SIDE OF HANGAR IS SIMILAR TO THE OFFICE SIDE.

NOTE: ①

O.Z. CABLE SUPPORTS TO BE INSTALLED IN ALL VERTICAL CONDUIT RUNS ON TRUSSES, IN A SIMILAR MANNER AS THAT SHOWN ON THIS DWG., EXCEPT THAT RUNS OF #4/0 WIRE TO BE SUPPORTED EVERY 80 FT. OF VERTICAL RUN.

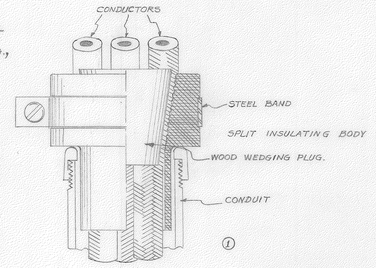

DETAIL "A" - O.Z. CABLE SUPPORT

NO SCALE

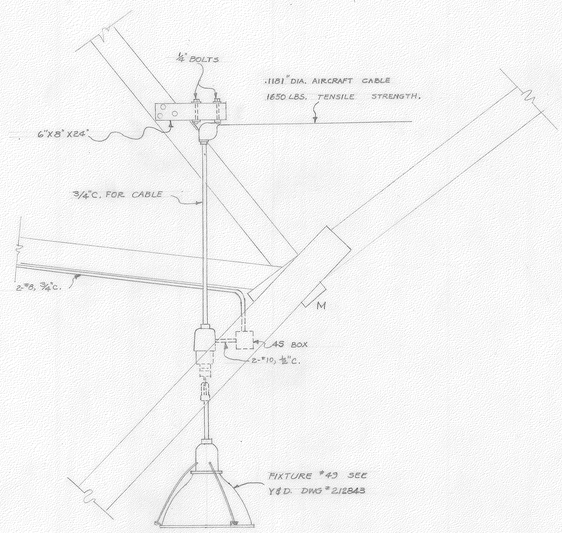

TYPICAL MOUNTING DETAIL

NO SCALE

300,331

2	ELH	5-25-43	ADDED LOWER FIXTURE & DETAIL "B"	JRR
1	ELH	5-14-43	ADDED CABLE SUPPORT	JRR
REVISION	BY	DATE	BRIEF	APP'D.

CONST. CONTRACT NOy 5424

NEWBERY–CHANDLER–TILLAMOOK
TILLAMOOK, OREGON.

DRAWN ELH
TRACED ELH
CHECKED
APP'D.
DATE

U. S. NAVAL AIR STATION (L.T.A.)
TILLAMOOK, OREGON
HANGAR "B" - ELECTRICAL DETAILS
MOUNTING METHOD FOR THOMPSON FIXTURES
SCALE ⅛" = 1'-0"
DATE APP'D. Apr 16, 1943
APPROVED
O F Norman
OFFICER IN CHARGE

DWG. NO. 9

SHEET OF

1335-45-16